



CERTIFICATE

This is to certify that the Quality Management System of

ECO-FRIENDLY GREEN BRICKS LTD.

North Lakkhinda, Sagordighi, Ghatail, Tangail-1984, Bangladesh

has been assessed and found to conform to the requirements of

ISO 9001:2015

This Certificate is valid for the following scope

**Manufacturing, Sales and Marketing of Autoclaved Aerated
Concrete (AAC) Blocks.**

Certificate No. : AMER23976
Original Issue Date : 22/01/2025
Issue Date : 22/01/2025 R0
Surveillance /Expiry Date : 21/01/2026
Recertification Date : 21/01/2028



Bhawanee

Director

AMERICO QUALITY STANDARDS REGISTECH PVT. LTD

Accredited by UAF, 1060 Laskin Rd, Suite: 12B/13B, Virginia Beach VA 23451, USA



CM-MS-7842





Mirpur Cantonment, Dhaka-1216

Centre for Advisory and Testing Services [CATS-MIST (CE)] Military Institute of Science and Technology

Compressive Strength of Brick

CATS Reference	: 2376/44674/Con/12/2024	Date	: 11.12.2024
Client	: Eco-Friendly Green Bricks Ltd. (Nextblock-Autoclaved)		
Project Name & Address	: Nextblock Autoclaved Aerated Concrete (AAC) Block, Eco-Friendly Green Bricks Ltd.		
Sample Brought By	: Engr. Md. Afzalul Islam Chowdhury		
Test Method	: ASTM C 1386	Date of Receiving	: 02.12.2024
Sample	: Precast Autoclaved Aerated Concrete (AAC) Block	Date of Testing	: 10.12.2024
Type	: Autoclaved Aerated Concrete (AAC)	Colour	: White
Actual Size	: 600mm (L) x 200mm (H) x 110mm (T)	Sample Condition	: Usealed
Prepared Size	: 200mm (L) x 200mm (H) x 110mm (T)	Quantity of Sample	: 3 Nos

Test Results

Sl No.	Frog Mark	Length	Width	Height	Area	Crushing Load	Crushing Strength	
		mm	mm	mm	mm ²	kN	MPa	psi
1	-	200.0	200.0	110.0	40000.0	172.2	4.3	620
2		200.0	200.0	110.0	40000.0	181.2	4.5	650
3		196.0	200.0	110.0	39200.0	172.2	4.4	640
Sample Strength Standard Deviation:							0.1	10

Remarks:

1. All information displayed above other than the test results are provided by the client.
2. CATS-MIST did not verify whether the samples are representative or not.

Test Supervised By:

Takwiir Tahriim Khan
Lecturer
Dept. of Civil Engineering
MIST, Mirpur Cantt. Dhaka
IEB-A/25134

Countersigned By:

Lt Col Md. Jahidul Islam, PhD, Engrs
FIEB, M. ASCE
Associate Professor & Instr CIA
Officer in Charge, Concrete Lab
Civil Engineering Department, MIST
Mirpur Cantonment, Dhaka

Note: Samples as supplied to us have been tested in our laboratory. CATS-MIST does not have any responsibility as to the representative character of the samples required to be tested. It is recommended that samples to be sent in secure and sealed cover/packet/container under signature of the competent authority in order to fraudulent fabrication of test results. It is recommended to collect all test reports by duly authorized person and not by the contractor/supplier himself.

BANGLADESH UNIVERSITY OF ENGINEERING AND TECHNOLOGY (BUET)



DEPARTMENT OF CIVIL ENGINEERING

Mobile: 01819557964; PABX: 55167100 Ext. 7226
http://brtc.ce.buet.ac.bd/#/home




STRENGTH OF MATERIALS LABORATORY

BRTC No. : 1103-19107 /CE/23-24; Dt: 2/4/2024
Sent by : Sr. Executive Technical, Eco-Friendly Green Bricks Ltd.
Ref. No. : Letter; Dt: 2/4/2024
Project : ---
Sample : Autoclave Aerated Concrete (AAC) Block (600×200×120 mm)
Test Specimen : Autoclave Aerated Concrete (AAC) Block
Test : Dry Bulk Density (ASTM C1386)
Date of Test : 25/4/2024 to 2/5/2024


TEST REPORT

Sl. No.	Nominal Size of Block	Specimen Length (mm)	Specimen Width (mm)	Specimen Height (mm)	Specimen Weight (gm)	Dry Bulk Density (kg/cu.m)	Average Dry Bulk Density (kg/cu.m)
1	600×200×120 mm	112.0	120.0	121.0	1,060	652	642
2		119.0	126.0	118.0	1,121	634	
3		120.0	122.0	118.0	1,107	641	

Note: Samples were received in unsealed condition.


Dr. Hasib Mohammed Ahsan
Professor
Department of Civil Engineering
BUET, Dhaka-1000, Bangladesh

Test Performed by:


Dr. Shameem Ahmed
Professor
Department of Civil Engineering
BUET, Dhaka-1000, Bangladesh



Important Notes: Samples as supplied to us have been tested in our laboratory. BRTC does not have any responsibility as to the representative character of the samples required to be tested. It is recommended that samples are sent in a secure and sealed cover/packet/container under signature of the competent authority. In order to avoid fraudulent fabrication of test results, it is recommended that all test reports are collected by duly authorized person, and not by the Contractor/Supplier.

BANGLADESH UNIVERSITY OF ENGINEERING AND TECHNOLOGY (BUET)



DEPARTMENT OF CIVIL ENGINEERING

Mobile: 01819557964; PABX: 55167100 Ext. 7226
http://brtc.ce.buet.ac.bd/#/home




STRENGTH OF MATERIALS LABORATORY

BRTC No. : 1103-19107 /CE/23-24; Dt: 2/4/2024
Sent by : Sr. Executive Technical, Eco-Friendly Green Bricks Ltd.
Ref. No. : Letter; Dt: 2/4/2024
Project : ---
Sample : Autoclave Aerated Concrete (AAC) Block (600×200×120 mm)
Test Specimen : Autoclave Aerated Concrete (AAC) Block
Test : Moisture Content (ASTM C1386)
Date of Test : 25/4/2024 to 2/5/2024


TEST REPORT

Sl. No.	Nominal Size of Block	Specimen Weight (gm)	Specimen Dry Weight (gm)	Weight of Water (gm)	Moisture Content (%)	Average Moisture Content (%)	Remarks
1	600×200×120 mm	1066	1,060	6	0.6	0.7	-
2		1130	1,121	9	0.8		-
3		1113	1,107	7	0.6		-

Note: Samples were received in unsealed condition.


Dr. Hasib Mohammed Ahsan
Professor
Department of Civil Engineering
BUET, Dhaka-1000, Bangladesh

Test Performed by:


Dr. Shameem Ahmed
Professor
Department of Civil Engineering
BUET, Dhaka-1000, Bangladesh



Important Notes: Samples as supplied to us have been tested in our laboratory. BRTC does not have any responsibility as to the representative character of the samples required to be tested. It is recommended that samples are sent in a secure and sealed cover/packet/container under signature of the competent authority. In order to avoid fraudulent fabrication of test results, it is recommended that all test reports are collected by duly authorized person, and not by the Contractor/Supplier.

BANGLADESH UNIVERSITY OF ENGINEERING AND TECHNOLOGY (BUET)



DEPARTMENT OF CIVIL ENGINEERING

Mobile: 01819 557 964; PABX: 966 5650-80 Ext. 7226; www.buet.ac.bd/ce/



ENVIRONMENTAL ENGINEERING LABORATORY

ANALYSIS OF SALINITY OF SAND SAMPLE

BRTC No. : 1102-96004/CE/23-24 **Date:** 17/07/2023

Sent By : Engr Md Afzalul Islam Chowdhury, Executive Technical Sales, Eco-Friendly Green Bricks Ltd.
Kashem Center (3rd Floor), 34 Bir Uttam CR Dutta Road, Hatirpool, Dhaka

Your Ref. : Letter **Date :** 17/07/2023

Project : Sand Salinity Test **Source :** Sand Sample

Sample Id : ... **Date of Testing :** 17-24 July 2023

TEST RESULT

Sl. No.	Sand Quality Parameter	Unit	Concentration Present
1	Water Soluble Chloride	%	0.0024

Note: The sample was received in unsealed condition.

Countersigned by:

Prof. Dr. Hasib Mohammed Ahsan
Test-In-Charge
Dept. of Civil Engineering, BUET

Test Performed by:

25/07/23

Dr. Md. Abdul Jalil
Professor
Dept. of Civil Engineering, BUET



Warning:

- Samples as supplied to us have been tested in our laboratory. BRTC does not have any responsibility as to the representative character of the samples required to be tested. It is recommended that samples are sent in a secure and sealed cover/packet/container under signature of the competent authority.
- In order to avoid fraudulent fabrication of the test results, it is recommended that all test reports are collected by duly authorized person, and not by the Contractor/Supplier.



Client : Mr. Mohammad Anwarul Alam
Manager-Brand & Marketing
Eco-Friendly Green Bricks Ltd.

Client's Reference : Nil; Date 24/02/2022

BRTC Reference : 1102-55189/MME/2021-22; Date 24/02/2022

Subject : Test of Autoclaved Aerated Concrete

Sample Condition : Not Sealed

20 March 2022
MME 0861/2021-22



Orglsju1fw

Please note: The client supplied the sample and the result given herewith corresponds to the sample tested only. The Department of Materials and Metallurgical Engineering of BUET takes no responsibility regarding the misidentification, if any, of the sample.

TEST REPORT

Sample Name (As per Client's Letter)	Autoclave Concrete Block
Dimension	600 mm x 250 mm x 200 mm

1. Thermal Conductivity


Sample Description	Sample No.	Test Method	Thermal Conductivity	Average Thermal Conductivity
			W/ (m K)	W/ (m K)
Autoclaved Aerated Concrete Block (600 mm x 250 mm x 200 mm)	1	ASTM D 7340 (Lee's Disc Method)	0.11	0.11
	2		0.11	
	3		0.12	

2. Sound Absorption (Test Method ASTM E 90)

Sample Description	Wall Size	Wall Thickness	Sound Measuring Apparatus	Maximum Sound recorded at source	Maximum Sound Transmitted through Wall	Transmission Loss
	mm	mm		dB	dB	%
Un-plastered Brick Wall with Autoclaved Aerated Concrete Block	1420 x 1200	250	Extech 407730 Digital Sound Level Meter	105	67	36

M. HASAN
20.3.22

Dr. Mahbub Hasan
Professor and Head



Client : Mr. Mohammad Anwarul Alam
Manager-Brand & Marketing
Eco-Friendly Green Bricks Ltd.
29, Bangabandhu Avenue
2nd Floor, Dhaka-1000

Client's Reference : Nil; Date : 26/07/2022

BRTC Reference : 1102-67077/MME/2022-23; Date : 27/07/2022

Subject : Test of Concrete Blocks

Sample Condition : Not Sealed

27 August 2022
MME 0111/2022-23



o079tjuli5

Please note: The client supplied the sample and the result given herewith corresponds to the sample tested only. The Department of Materials and Metallurgical Engineering of BUET takes no responsibility regarding the misidentification, if any, of the sample.

TEST REPORT

Fire Endurance Test (ASTM E 119)

Sample Description	Wall Size	Wall Thickness	Test Temperature	Maximum Temperature recorded	Test Duration
	mm ²	mm	°C	°C	minute
Autoclaved Aerated Concrete Block Wall	1000 × 610	120	As per Fig. 1	1250±5	275

Observations	Passage of Flame and Smoke	Maximum Temperature at Unexposed Side (°C)	Post Test
		Nil	60

* Concrete blocks turned brownish and numerous cracks appeared at the exposed surface (Fig. 2).

Rashid 27/8/22

Dr. A.K.M. Bazlur Rashid
Professor and Head

Page 1 of 2

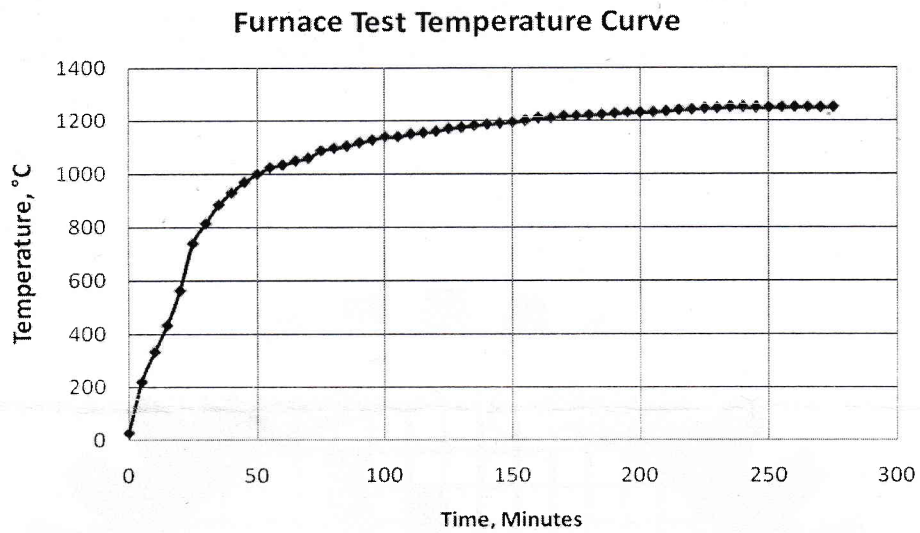



Fig. 1: Showing the temperature rise of the furnace with time during the test.

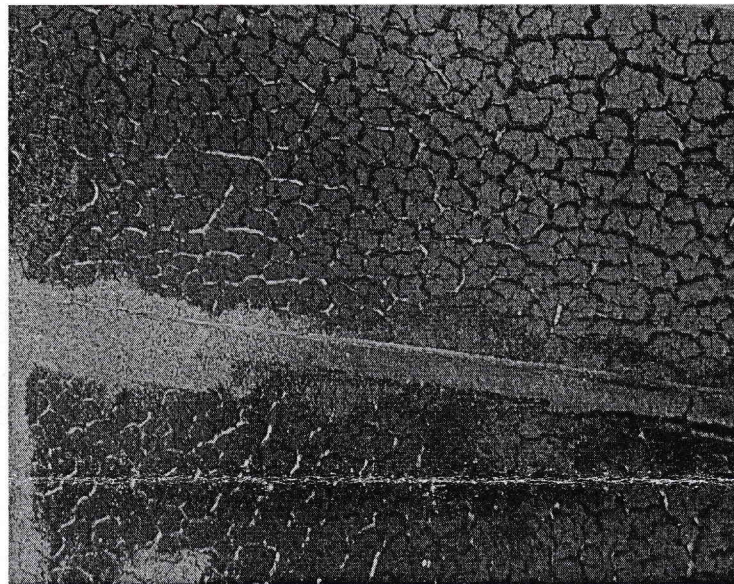


Fig. 2 Section of the block wall showing cracks in the concrete blocks.

Rashid 27/8/22

Dr. A.K.M. Bazlur Rashid
Professor and Head

